

AIR CONDITIONING & VENTILATION SYSTEM FOR GIS BUILDING

- 2.4.1.1 Outdoor unit shall comprise of hermetically/ semi hermetically sealed compressors mounted on vibration isolators, fans and copper tube aluminium finned coils all assembled in a sheet metal casing. The casing and the total unit shall be properly treated and shall be weatherproof type. They shall be compact in size and shall have horizontal discharge of air.
- 2.4.1.2 Indoor units shall be of 4-way, ceiling mounted cassette type. The indoor unit shall be compact and shall have elegant appearance. They shall have low noise centrifugal blowers driven by suitable motors and copper tube aluminium finned cooling coils. Removable and washable polypropylene filters shall be provided. They shall be complete with multi function cordless remote control unit with special features like programmable timer, sleep mode etc.
- 2.4.1.3 Cooling capacity of 3TR AC units shall not be less than 36000btu/hr. and shall have energy efficiency rating of 5 star as on the date of NOA.
- 2.4.2 **High wall type split AC units**
 - 2.4.2.1 The split AC units shall be complete with indoor evaporator unit, outdoor condensing units and cordless remote control units.
 - 2.4.2.2 Outdoor unit shall comprise of hermetically/semi hermetically sealed compressors mounted on vibration isolators, propeller type axial flow fans and copper tube aluminium finned coils all assembled in a sheet metal casing. The casing and the total unit shall be properly treated and shall be weatherproof type. They shall be compact in size and shall have horizontal discharge of air.
 - 2.4.2.3 The indoor units shall be high wall type. The indoor unit shall be compact and shall have elegant appearance. They shall have low noise centrifugal blowers driven by suitable motors and copper tube aluminium finned cooling coils. Removable and washable polypropylene filters shall be provided. They shall be complete with multi function cordless remote control unit with special features like programmable timer, sleep mode and soft dry mode etc.
 - 2.4.2.4 Cooling capacity of 2TR AC units shall not be less than 22000btu/hr. and shall have energy efficiency rating of 5 star as on the date of NOA.
- 2.5 The Split AC units shall be of Carrier, Voltas, Blue Star, Hitachi, Daikin, LG, National, O'General, or Samsung make.
- 2.6 Controllers shall be provided in Local Control room inside GIS hall, one

AIR CONDITIONING & VENTILATION SYSTEM FOR GIS BUILDING

controller for each room, to control and monitoring of AC units and shall have the following facilities;

- Standby units shall come in to operation automatically when the running main unit fails
- Main and standby units shall be changed over periodically which shall be finalised during detailed engineering.
- Following alarms shall be provided:
 - a. Compressor On/OFF condition of each unit
 - b. Compressor failure of each unit
 - c. Power OFF to AC unit
 - d. High temperature in room.

2.7

Warranty

All compressors shall have minimum 5 years Warranty from the date of commissioning.

Ventilation system for GIS Hall

Each GIS Hall shall have an independent ventilation system. Each Ventilation system shall consist of two 100% capacity systems, one operating and one stand-by.


To ensure that the air being supplied to the GIS hall is free from dust particles, a minimum two stage dust filtration process shall be supplied. This shall consist of at least the following:

1. Pre Filters: To remove dust particles down to 10 micron in size with at least 95% efficiency.
2. Fine Filters: To remove dust particles down to 5 microns in size with at least 99% efficiency.

All the filters shall be panel type. Easy access should be available to the filters for replacement/cleaning.

The ventilation of the GIS hall shall be of a positive pressure type with minimum 2 air changes per hour. The pressure inside the GIS hall shall be maintained 5 mm of water above the atmospheric pressure. Fresh outdoor air shall be filtered before being blown into the GIS hall by the air fans to avoid dust accumulation on components present in the GIS hall. GIS hall shall be provided with motorized exhaust dampers with local control.

TYPICAL ARCHITECTURAL DRAWING OF SUBSTATION AUTOMATION SYSTEM (Without Process Bus) for New Substation

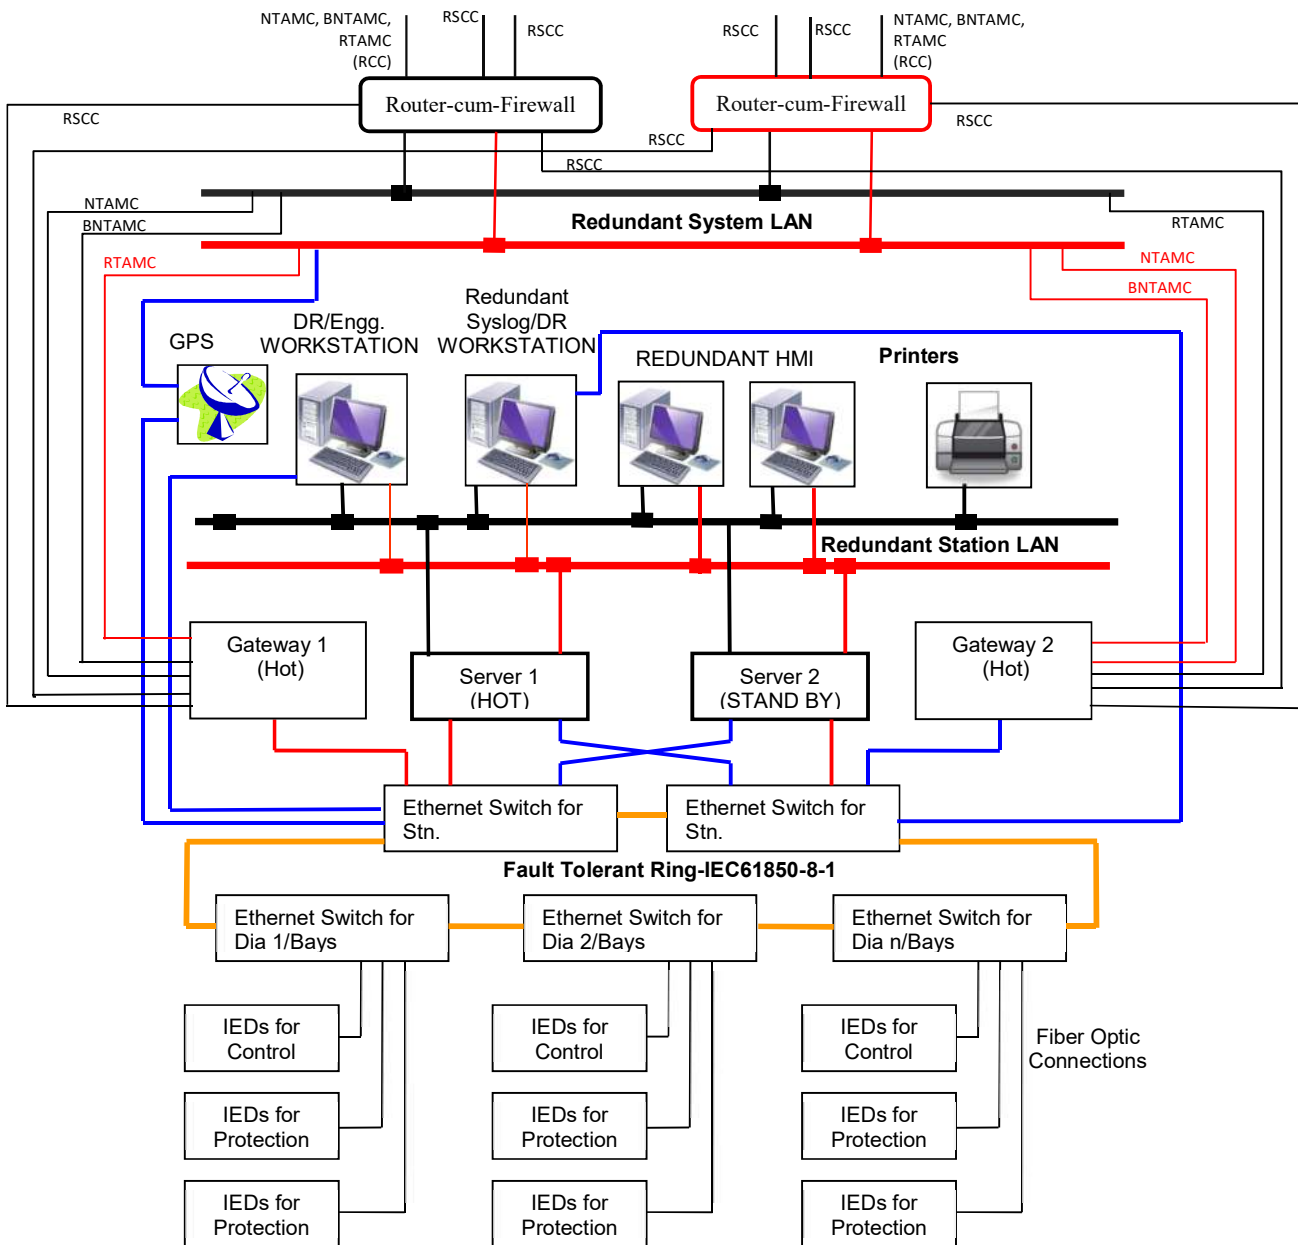

Note:

1. The redundant managed bus (station LAN) shall be realized by high speed optical bus using industrial grade components and shall be as per IEC 61850.
2. Inside the sub-station, all connections shall be realized as per IEC 61850 protocol.
3. For gateway, it shall communicate with Remote Supervisory Control Centre (RSCC) on IEC 60870-104 protocol. The number of ports required shall be as per clause no. 1.1 and 3.3 of this specification.
4. The printer as required shall be connected to station bus directly and can be managed either from station HMI, HMI view node or disturbance recorder work stations.
5. The above layout is typical. However if any contractor offers slightly modified architecture based on their standard practice without compromising the working, the same shall be subject to approval during detailed engineering.
6. RCC means NTAMC/RTAMC. Similarly, RSCC could be SLDC for state owned substations/bays.
7. Syslog server to be Linux based. However DR/Engg. PC workstation can be other Operating System.

SPECIFICATIO FOR SWITCHES**Substation System LAN:**

2 (two) nos. managed Ethernet switches with 16 copper 10/100 Mbps RJ45 ports on each switch shall be supplied to form redundant system LAN as shown in typical architecture drawing. These switches shall be different from IEC 61850 LAN and specifically used for the purpose of connecting various devices of different sub-systems (SCADA, VMS, VOIP etc.) for integration with NTAMC/RTAMC. These switches shall be suitable for substation environment and shall comply with the requirements of IEC 61850-3 standard for EMI/EMC.

These LAN switches shall have the following compliance and functional features:

- (a) Compliance as per NERC-CIP-3, NERC-CIP-5. NERC-CIP-7 standard for cyber security
- (b) Support SNMPv3 (Full SNMP support including Traps)
- (c) Web based GUI or CLI based with HTTPS/HTTP and SSH/ Telnet support
- (d) Support for IPv4 and IPv6 switching simultaneously
- (e) Layer 3 Static routing functionality
- (f) Syslog facility for local as well as remote server
- (g) Support for remote management
- (h) LED indication for port status/supply etc.
- (i) Shall support VLAN IEEE 802.1Q
- (j) IGMP snooping
- (k) Spanning tree protocol IEEE 802.1d or RSTP IEEE 802.1w
- (l) Shall support SNTP
- (m) Port based Network Access Control (IEEE 802.1x)
- (n) Quality of Service (IEEE 802.1p)
- (o) Shall support unicast as well as multicast IP traffic
- (p) SNTP time synchronization
- (q) Shall support Mac Binding
- (r) Fanless design

Technical Specification for Visual Monitoring System**Visual monitoring system for watch and ward of Substation premises :**

Visual monitoring system (VMS) for effective watch and ward of sub station premises covering the areas of entire switchyard, Control Room cum Administrative building, Fire fighting pump house, stores and main gate, shall be provided. The contractor shall design, supply, erect, test and commission the complete system including cameras, Digital video recorder system, mounting arrangement for cameras, cables, LAN Switches, UPS and any other items/accessories required to complete the system. To provide all the necessary licenses to run the system successfully shall be in the scope of contractor.

System with Color IP Cameras for VMS surveillance would be located at various locations including indoor areas and outdoor switchyard and as per the direction of Engineer-In-Charge. The VMS data partly/completely shall be recorded (minimum for 15 days) and stored on network video recorder.

The number of cameras and their locations shall be decided in such a way that any location covered in the area can be scanned. The cameras shall be located in such a way to monitor at least:

1. The operation of each and every isolator pole of the complete yard in case of AIS Sub-station.
2. The Operation of each bay(s) of GIS Hall as Applicable.
3. All the Transformer and Reactors All the Entrance doors of Control Room Building and Fire-fighting Pump House, GIS Hall and Switchyard Panel room as applicable.
4. All the gates of switchyard.
5. Main entrance Gate
6. All other Major AIS Equipment (such as CB, CT, CVT, SA etc. as applicable)

The cameras can be mounted on structures, buildings or any other suitable mounting arrangement to be provided by the contractor.

1.1 Technical requirements of major equipment of Visual Monitoring System.

- 1.1.1 The Video Monitoring system shall be an integrated system with IP network centric functional and management architecture aimed at providing high-speed manual/automatic operation for best performance.
- 1.1.2 The system should facilitate viewing of live and recorded images and controlling of all cameras by the authorized users.
- 1.1.3 The system shall use video signals from various types of indoor/outdoor CCD colour cameras installed at different locations, process them for viewing on

Technical Specification for Visual Monitoring System

workstations/monitors in the control Room and simultaneously record all the cameras after compression using **H 264**/MPEG 4 or better standard. Mouse/Joystick-Key-board controllers shall be used for Pan, Tilt, Zoom, and other functions of desired cameras.

1.1.4 The System shall provide sufficient storage of all the camera recordings for a period of 15 days or more @ 25 FPS, at 4 CIF or better quality using necessary compression techniques for all cameras. It shall be ensured that data once recorded shall not be altered by any means. The recording resolution and frame rate for each camera shall be user programmable.

1.1.5 The surveillance VMS System shall operate on 230 V, 50 Hz single-phase power supply. System shall have back up UPS power supply meeting the power supply need of all the cameras in the stations including those which are installed at gate for a period of 2 hours. The bidder shall submit the sizing calculation for the UPS considering the total load requirement of Video Monitoring System.

1.2 System requirements:

- a) System must provide built-in facility of watermarking or Digital certificate to ensure tamperproof recording.
- b) All cameras may be connected through a suitable LAN which shall be able to perform in 765kV class sub-station environment without fail.
- c) All camera recordings shall have Camera ID & location/area of recording as well as date/time stamp. Camera ID, Location/Area of recording & date/time shall be programmable by the system administrator with User ID & Password.
- d) Facility of camera recording in real-time mode (25 FPS)/15/12.5/10 or lower FPS as well as in any desired combination must be available in the system.
- e) Facility of Camera recording in **HD (1280X720p)**, **D1** , **4CIF** , **CIF**, **VGA**, as well as in any combination i.e. any camera can be recorded in any quality.
- f) System to have facility of **100%** additional camera installation beyond the originally planned capacity.
- g) In order to optimize the memory, while recording, video shall be compressed using **H 264**/MPEG-4 or better standard and streamed over the IP network.
- h) System shall be triplex i.e. it should provide facility of Viewing, Recording & Replay simultaneously.
- i) The offered system shall have facility to export the desired portion of clipping (from a specific date/time to another specific date/time) on CD or DVD. Viewing of this recording shall be possible on standard PC using standard software like windows media player etc.
- j) System shall have provision of WAN connectivity for remote monitoring.
- k) The equipment should generally conform to Electro magnetic compatibility requirements for outdoor equipment in EHV switchyards. The major EMC required for Cameras and other equipment shall be as under:

1. Electrical Fast Transient (Level 4)

– As per IEC 61000-4-4

Technical Specification for Visual Monitoring System

- | | |
|--|-------------------------|
| 2. Damped Oscillatory (1 MHz and 100 KHz) (level 3) | - As per IEC 61000-4-18 |
| 3. AC Voltage Dips & Interruption/Variation (class 3) | - As per IEC 61000-4-11 |
| 4. Electrostatic Discharge (Level 4) | - As per IEC 61000-4-2 |
| 5. Power Frequency Magnetic Field (level 4) | - As per IEC 61000-4-8 |
| 6. Ripple on DC input Power Supply Port immunity test(level 4) | - As per IEC 61000-4-17 |

Type test reports to establish compliance with the above requirement shall be submitted during detailed engineering.

1.2.1 VIDEO SURVEILLANCE APPLICATION SOFTWARE

- a) Digital video surveillance control software should be capable to display and manage the entire surveillance system. It should be capable of supporting variety of devices such as cameras, video encoder, Servers, NAS boxes/Raid backup device etc.
- b) The software should have inbuilt facility to store configuration of encoders and cameras.
- c) The software should Support flexible 1/2/4/8/16/32 Windows Split screen display mode and scroll mode on the PC monitor.
- d) The software should be able to control all cameras i.e. PTZ control, Iris control, auto / manual focus, and color balance of camera, Selection of presets, Video tour selection etc.
- e) The software should have user access authority configurable on per device or per device group basis. The system shall provide user activity log with user ID, time stamp, action performed, etc.
- f) The users should be on a hierarchical basis as assigned by the administrator. The higher priority person can take control of cameras, which are already being controlled by a lower priority user.
- g) It should have recording modes viz. continuous, manual, or programmed modes on date, time and camera-wise. All modes should be disabled and enabled using scheduled configuration. It should also be possible to search and replay the recorded images on date, time and camera-wise. It should provide onscreen controls for remote operation of PTZ cameras. It should have the facility for scheduled recording. Different recording speeds (fps) and resolution for each recording mode for each camera should be possible.
- h) The software for clients should also be working on a browser based system for remote users. This will allow any authorized user to display the video of any desired camera on the monitor with full PTZ and associated controls.
- i) Retrieval: The VMS application should allow retrieval of data instantaneously or any date / time interval chosen through search functionality of the application software. In case data is older than 15 days and available, the retrieval should be possible. The system should also allow for backup of specific data on any drives like DVD's or any other device in a format which can be replayed through a standard PC based software. Log of any such activity should be maintained by the system.
- j) VMS shall provide the full functionality reporting tool which can provide

Technical Specification for Visual Monitoring System

reports for user login/logoff, camera accessibility report, server health check reports etc.

1.2.2 Network video recorder

The Network Video recorder shall include at least Server (min 3.0 GHZ, 4GB RAM, 3000GB HDD(min)), RAID 5 ,with suitable configuration along with Colored TFT 22" High resolution monitor, and Internal DVD writer. Windows XP/Vista/7 Prof. or VMS compatible operating system latest version with hardware like graphic cards, licensed Anti-virus etc.

Further the digital video recorder shall conform to the following requirements:

1.	Server Spec	Intel Quad Core (or better) 3.0 Ghz (min.) , 8 MB Cache , 4 GB memory , with suitable NVIDIA graphics card,3 TB HDD , Raid 5
2.	Recording and Display Frame Rate	Real-time 25 frames per second per channel , manual select
3.	Recording Resolution	(PAL): 1280X720 , 704(H) x 586(V) It should be possible to select lower resolutions
4.	Compression Method	H.264/MPEG-4 or better and latest
5.	Video Motion Detection Capable	Standard and built-in (selectable in menu)
6.	Monitoring Options	Split screen 1, 2, 4 , 8, 16, 32 or more cameras
7.	Playback Options	Search, still image capture
8.	Alarm/Event Recording Capable	To be provided with built-in external alarm input/ output ports minimum(8 in, 2 out)
9.	Network Operation Capable	To be provided by using WAN or LAN router
10.	Remote Internet Viewing Capable	Using WAN or LAN router
11.	HDD Storage Consumption	1GB ~ per hour / channel variable based on frame speed and resolution settings, as well as compression
12.	Operation	Triplex operation (simultaneous recording, playback, network operation)
13.	Number of Video Channel	32
14.	Audio Recording Capable	32
15.	Input Voltage	230V AC or equivalent with UPS as a back up for 30 minutes.

Technical Specification for Visual Monitoring System

1.2.3 VMS Camera

- a) The color IP camera for substation shall have PAN, TILT and ZOOM facilities so that it can be focused to the required location from the remote station through a controller. Whereas wireless IP cameras with PTZ controls are required for installation at gates of the POWERGRID premises as per the direction of Engineer-In-Charge
- b) The IP Camera at the main gate can be fixed or PTZ based and shall be used for monitoring entry and exit
- c) It should have sufficient range for viewing all the poles of isolators and other equipments with high degree of clarity.
- d) The VMS camera shall be suitable for wall mounting, ceiling mounting and switchyard structure mounting.
- e) It shall be possible to define at 128 selectable preset locations so that the camera gets automatically focused on selection of the location for viewing a predefined location.
- f) The camera should be able to detect motion in day & night environments having light intensity of Color: 0.5 Lux; B&W:0.05 Lux
- g) Housing of cameras meant for indoor use shall be of IP 42 or better rating whereas outdoor camera housing shall be of IP 66 or better rating. Housing shall be robust and not have the effect of electromagnetic induction in 765/400KV switchyard.
- h) All camera recordings shall have Camera ID & location/area of recording as well as date/time stamp. Camera ID, Location/Area of recording & date/time shall be programmable by the system administrator with User ID & Password
- i) Facility of camera recording in real-time mode (25 FPS)/15/12.5/10 or lower FPS as well as in any desired combination must be available in the system.

A. Outdoor IP Fixed Megapixel Camera Specifications (For Main Gate)

1.	Image Sensor	2-megapixel Progressive ,1 / 3" CMOS/CCD sensor, Minimum illumination 0.1 Lux
2.	Min Luminous	0.5LUX(Color) 0.05Lux(Black)
3.	Camera Enclosure Type	IP66 Grade
4.	Iris/Focus	Auto/Manual
5.	Video Compression	Dual Stream H.264 and MPEG 4 user selectable
6.	Support Dual-stream	primary/secondary stream, H.264/MPEG 4 optional
7.	Video Definition	Primary stream:1600x1200,1280x960,1280x720, Secondary stream:800x600,400x288,192x144
8.	Video Parameters	Brightness, hue, contrast, saturation and image quality

Technical Specification for Visual Monitoring System

9.	Video Frame Rate	PAL: 1-25frames/second NTSC:1-30frames/second
10.	Video Compression BR	32Kbit/S - 6Mbit/S
11.	Video Output	One channel composite Streaming
12.	Supported Protocols	TCP, UDP, IP, HTTP, FTP, SMTP, DHCP, DNS,ARP, ICMP, POP3, NTP, IPsec, UpnP, RTP, RTCP
13.	Operating Temperature	-5 ~ +50°C
14.	Operating Humidity	10 ~ 90%

B. Outdoor IP66 PTZ HD Camera Specifications (For Switch Yards)

1.	Image sensor	1/3 type Solid State Progressive Scan CCD,WDR(High Definition)
2.	Security	Multiple user access with password protection
3.	Effective Pixels	(PAL): Main Stream : 1280x720 Sub Stream : 640x360、320x280 selectable
4.	Compression	Dual Stream H.264 and MPEG 4 user selectable
5.	Signal System	50 Hz
6.	S/N (signal to noise) Ratio	Better than 50 dB
7.	Electronic Shutter	1/60 ~ 1/10,000 sec. automatic or better
8.	Scanning System	Progressive/interlace
9.	Low Light Sensitivity (lux)	Color: 0.5 Lux; B&W:0.02 Lux
10.	Lens	Minimum 10x (minimum) optical in High Definition (The system shall be able to zoom the images on the monitor without any distortion to the maximum level of optical zoom)
11.	Lens Size	Minimum 4.1~73.8 mm
12.	Lens Aperture	F1.6(wide)~F2.8(tele), f=4.1~41.0mm, 10X Zoom, Video Auto Focus Angle of View Horizontal : 52°(wide) , 2.8°(tele)
13.	PTZ Data Transfer Baud/Bit Rates Supported	Selectable 2400 bps / 4800 bps / 9600 bps
14.	Panning Range	Complete 360 degrees (horizontal)
15.	Pan Speed	Adjustable, 0.1 degrees / second ~ 250 degrees / second
16.	Tilting Range	Minimum 180° Tilt Rotation
17.	Tilt Speed	Adjustable, 0.1 degrees / second ~ 150 degrees / second
18.	In Built Storage	Camera should have inbuilt storage TF or SD

Technical Specification for Visual Monitoring System

		format for recording and storing Pictures
19.	IP Class	IP66 Standard
20.	Working temperature	-0°C ~ +50°C
21.	Working Humidity	10 ~ 90%

1.2.4 PTZ-Keyboards

The features of PTZ shall include:

- Fully functional dynamic keyboard/joystick controllers
- Controls all pan, tilt, zoom, iris, preset functions
- Control up to 255 units from a single keyboard
- Many preset options and advanced tour programming
- Compatible with all connected cameras

1.	Key Application	wired keyboard control operation of PTZ functions for weatherproof dome cameras
2.	Pan / Tilt / Zoom Protocol Languages Supported	Selectable
3.	PTZ Data Transfer Baud Rates Supported	selectable 1200 bps / 2400 bps / 4800 bps / 9600 bps
4.	Additional Features	dynamic joystick for smooth camera movements, preset location option for quick access to frequently monitored areas